


# 236000D02 CENTRAL COOLING EQUIPMENT

## Building Pumping

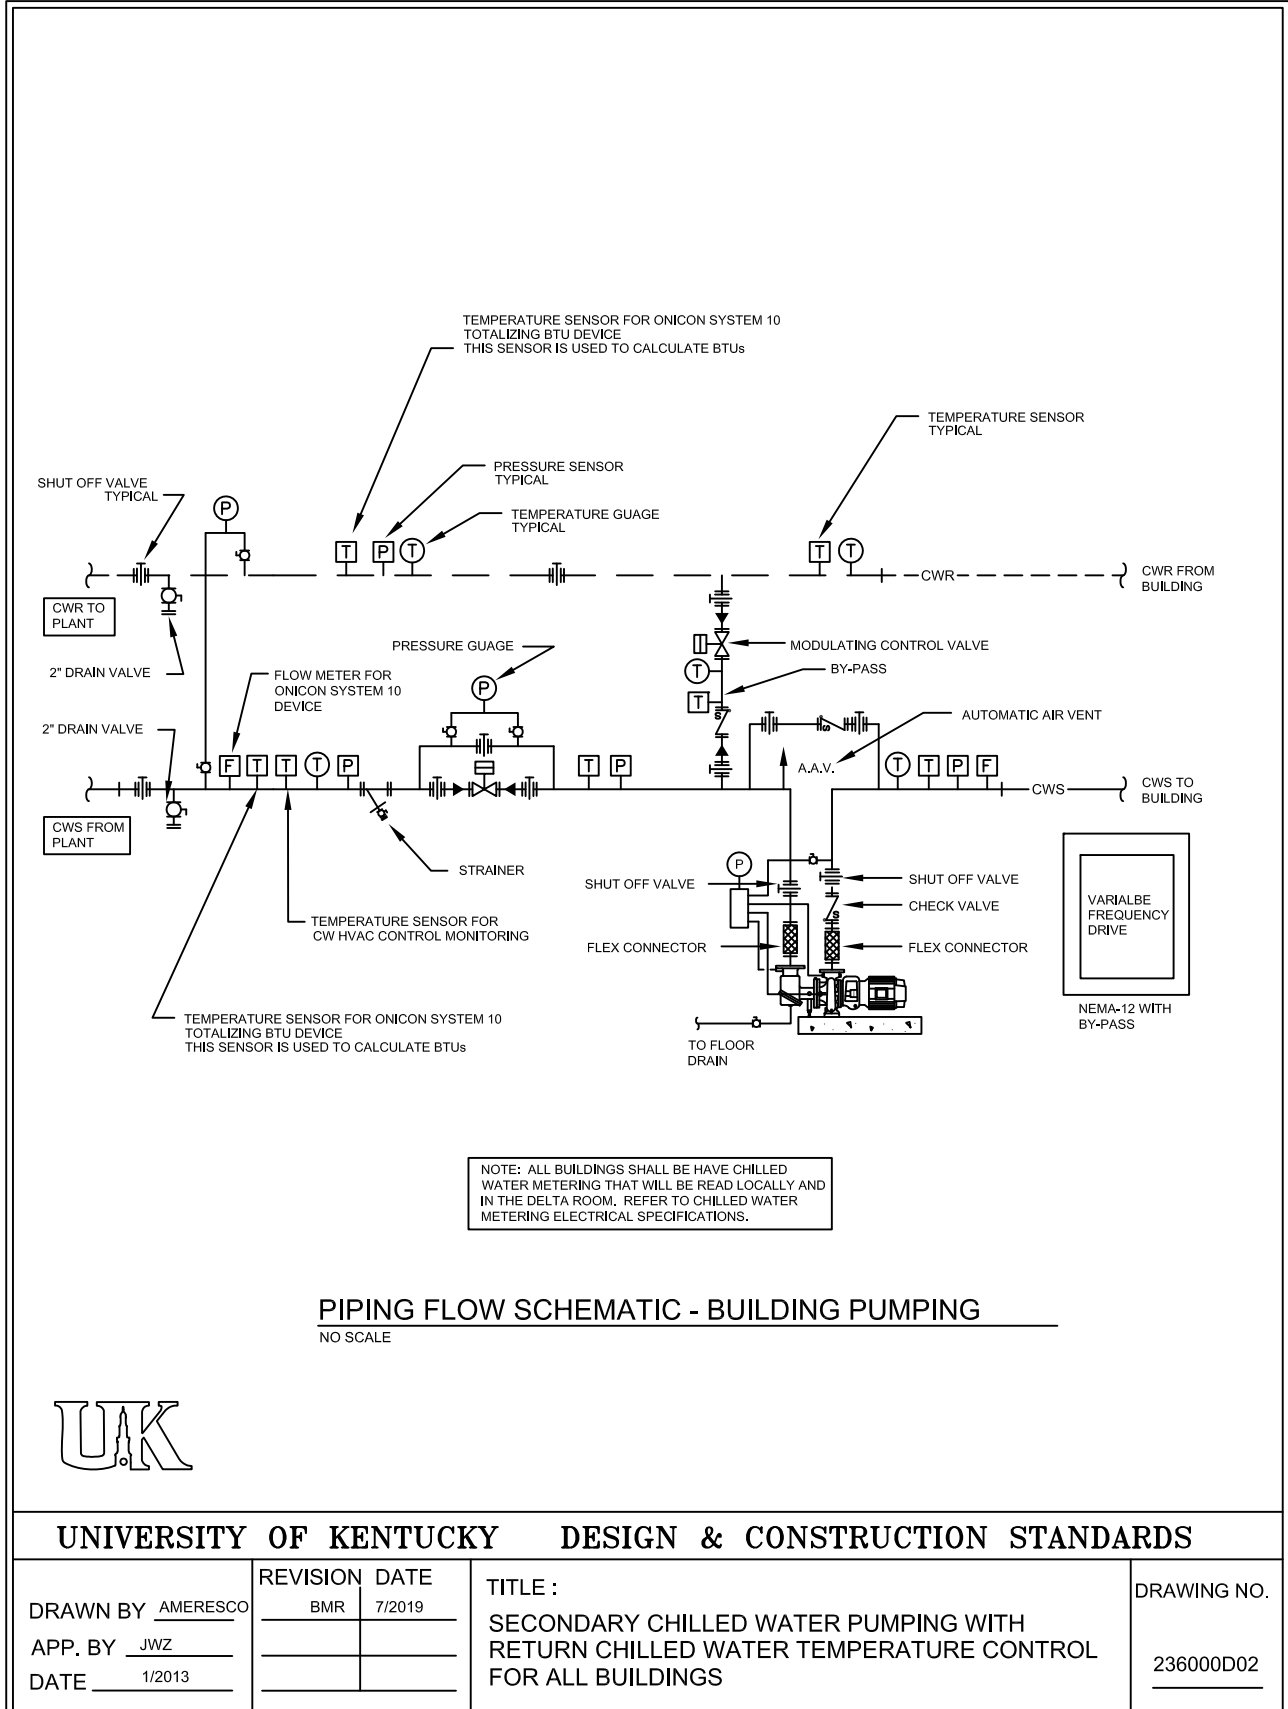

PIPING FLOW SCHEMATIC - BUILDING PUMPING

NO SCALE



### UNIVERSITY OF KENTUCKY DESIGN & CONSTRUCTION STANDARDS

DRAWN BY <u>AMERESCO</u> APP. BY <u>JWZ</u> DATE <u>1/2013</u>	REVISION DATE <u>BMR 7/2019</u>	TITLE : SECONDARY CHILLED WATER PUMPING WITH RETURN CHILLED WATER TEMPERATURE CONTROL FOR ALL BUILDINGS	DRAWING NO. <u>236000D02</u>
--	------------------------------------	--	---------------------------------