

FCR 19

Office of the President
September 5, 2014

Members, Board of Trustees:


REPAIR/UPGRADE/IMPROVE BULDING SYSTEMS –
UK HEALTHCARE CAPITAL PROJECT
(GOOD SAMARITAN HOSPITAL AIR HANDLING UNITS #20 AND #22)

Recommendation: that the Board of Trustees approve the initiation of the Repair/Upgrade/Improve Building Systems – UK HealthCare Capital Project (Good Samaritan Air Handling Units #20 and #22).

Background: This project will replace the air handling units (AHU) #20 and #22 in Good Samaritan Hospital. Patient areas on the ground and first floors are heated and cooled by AHU #20, while the first floor kitchen area is serviced by AHU #22. These units are 38 years old, in poor mechanical condition, and do not provide sufficient airflow to meet current code requirements. Replacement of these AHUs is necessary to ensure patient and staff comfort, air quality and compliance with other regulatory requirements.

This project has been authorized by the 2014 Session of the Kentucky General Assembly as part of a \$20,000,000 infrastructure pool for UK HealthCare facilities. The project cope is \$1,500,000 and will be funded with agency funds.

Action taken: Approved Disapproved Other _____

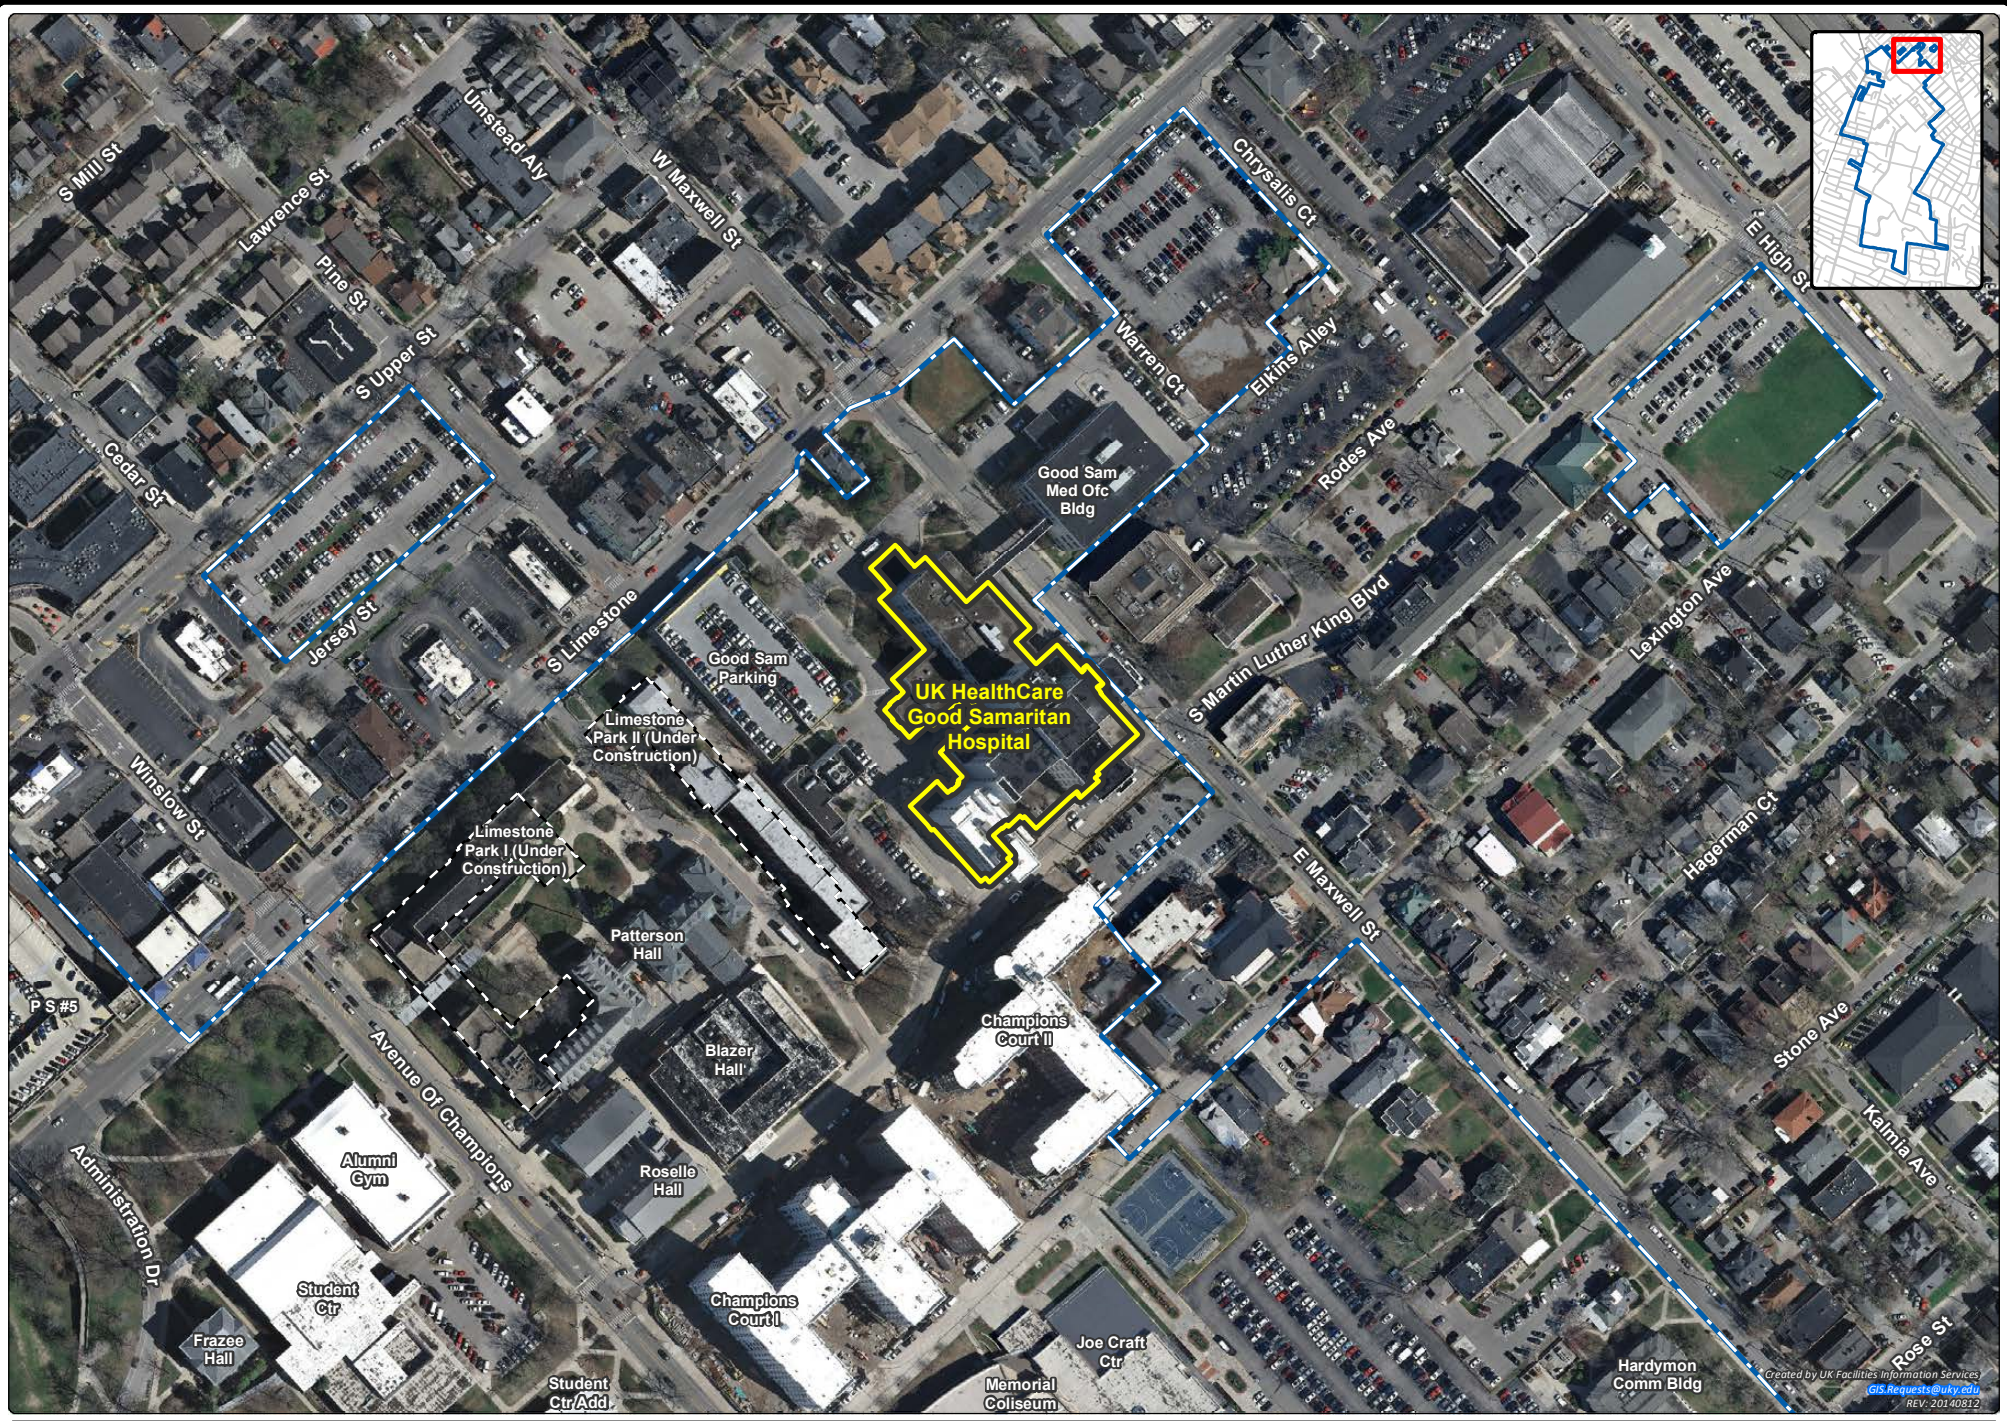

Created by UK Facilities Information Services
GIS.Requests@uky.edu
REV: 20140812



**FCR 19 - REPAIR/UPGRADE/IMPROVE BUILDING SYSTEMS - UK HEALTHCARE
CAPITAL PROJECT (GOOD SAMARITAN HOSPITAL AIR HANDLING UNITS #20 AND #22)**

